

Altistart 22, Soft starter, ATS22 control 220V power 230V(11kW)/400...440V(22kW)

ATS22D47Q

Main

| Range of product | Altistart 22 | | | | | |
|------------------------------|--|--|--|--|--|--|
| Product or component type | Soft starter | | | | | |
| Product destination | Asynchronous motors | | | | | |
| Product specific application | Pumps and fans | | | | | |
| Component name | ATS22 | | | | | |
| Network number of phases | 3 phases | | | | | |
| [Us] rated supply voltage | 230440 V - 1510 % | | | | | |
| Motor power kW | 11 kW 230 V 22 kW 400 V 22 kW 440 V | | | | | |
| Factory setting current | 42 A | | | | | |
| Power dissipation in W | 48 W for standard applications | | | | | |
| Utilisation category | AC-53A | | | | | |
| Type of start | Start with torque control (current limited to 3.5 ln) | | | | | |
| IcL starter rating | 47 A for connection in the motor supply line for standard applications | | | | | |
| IP degree of protection | IP20 | | | | | |

Complementary

| Assembly style | With heat sink | | | |
|------------------------------|---|--|--|--|
| Function available | Internal bypass | | | |
| Supply voltage limits | 195484 V | | | |
| Supply frequency | 5060 Hz - 1010 % | | | |
| Network frequency | 4566 Hz | | | |
| Device connection | To the motor delta terminals In the motor supply line | | | |
| [Uc] control circuit voltage | 230 V - 1510 % 50/60 Hz | | | |
| Control circuit consumption | 20 W | | | |
| Discrete output number | 2 | | | |
| Discrete output type | Relay outputs R1 230 V running, alarm, trip, stopped, not stopped, starting, ready C/O Relay outputs R2 230 V running, alarm, trip, stopped, not stopped, starting, ready C/O | | | |
| Minimum switching current | 100 mA at 12 V DC (relay outputs) | | | |

| 5 A 250 V AC resistive 1 relay outputs 5 A 30 V DC resistive 1 relay outputs 2 A 250 V AC inductive 0.4 20 ms relay outputs 2 A 30 V DC inductive 7 ms relay outputs | | | | | | |
|---|--|--|--|--|--|--|
| 3 | | | | | | |
| (LI1, LI2, LI3) logic, 5 mA 4.3 kOhm | | | | | | |
| 24 V <= 30 V | | | | | | |
| Positive logic LI1, LI2, LI3 at State 0: < 5 V and <= 2 mA at State 1: > 11 V, >= 5 mA | | | | | | |
| 0.41 lcl adjustable | | | | | | |
| 750 Ohm | | | | | | |
| Modbus 1 RJ45 | | | | | | |
| 1 RJ45 Serial | | | | | | |
| Serial | | | | | | |
| RS485 multidrop | | | | | | |
| 4800, 9600 or 19200 bps | | | | | | |
| 31 | | | | | | |
| Phase failure: line Thermal protection: motor Thermal protection: starter | | | | | | |
| CE | | | | | | |
| Forced convection | | | | | | |
| Vertical +/- 10 degree | | | | | | |
| 265 mm | | | | | | |
| 130 mm | | | | | | |
| 169 mm | | | | | | |
| 7 kg | | | | | | |
| 711 kW at 200240 V 3 phases 1525 kW at 380440 V 3 phases | | | | | | |
| Soft starter | | | | | | |
| | | | | | | |
| Conducted and radiated emissions level A conforming to IEC 60947-4-2 Damped oscillating waves level 3 conforming to IEC 61000-4-12 Electrostatic discharge level 3 conforming to IEC 61000-4-2 Immunity to electrical transients level 4 conforming to IEC 61000-4-4 Immunity to radiated radio-electrical interference level 3 conforming to IEC 61000-4-3 Voltage/current impulse level 3 conforming to IEC 61000-4-5 | | | | | | |
| EN/IEC 60947-4-2 | | | | | | |
| CCC C-Tick UL GOST CSA | | | | | | |
| 1 gn (f= 13200 Hz) conforming to EN/IEC 60068-2-6 1.5 mm (f= 213 Hz) conforming to EN/IEC 60068-2-6 | | | | | | |
| 15 gn for 11 ms conforming to EN/IEC 60068-2-27 | | | | | | |
| 45 dB | | | | | | |
| Level 2 conforming to IEC 60664-1 | | | | | | |
| 095 % without condensation or dripping water conforming to EN/IEC 60068-2-3 | | | | | | |
| | | | | | | |
| -1040 °C (without derating) 4060 °C (with current derating 2.2 % per °C) | | | | | | |
| | | | | | | |

| Operating altitude | <= 1000 m without derating |
|--------------------|--|
| | > 1000< 2000 m with current derating of 2.2 % per additional 100 m |

Packing Units

| Unit Type of Package 1 | PCE |
|------------------------------|-----------|
| Number of Units in Package 1 | 1 |
| Package 1 Height | 26.924 cm |
| Package 1 Width | 22.098 cm |
| Package 1 Length | 33.274 cm |
| Package 1 Weight | 5.606 kg |
| Unit Type of Package 2 | P06 |
| Number of Units in Package 2 | 10 |
| Package 2 Height | 73.5 cm |
| Package 2 Width | 80 cm |
| Package 2 Length | 60 cm |
| Package 2 Weight | 69.76 kg |

Offer Sustainability

| REACh Regulation | REACh Declaration | | |
|----------------------------|---|--|--|
| EU RoHS Directive | Pro-active compliance (Product out of EU RoHS legal scope) EU RoHS Declaration Yes | | |
| Mercury free | | | |
| China RoHS Regulation | China RoHS declaration | | |
| RoHS exemption information | Yes | | |
| WEEE | The product must be disposed on European Union markets following specific waste collection and never end up in rubbish bins | | |


Contractual warranty

Warranty 18 months

Dimensions Drawings

Frame Size A

Dimensions

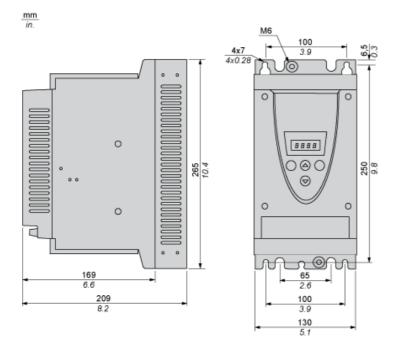

ATS22D47Q

Mounting and Clearance

Precautions

Standards

The Altistart 22 soft starter is compliant with pollution Degree 2 as defined in NEMA ICS1-1 or IEC 60664-1.

For environment pollution degree 3, install the Altistart 22 soft starter inside a cabinet type 12 or IP54.

DANGER


HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

ATS22 soft starters are open devices and must be mounted in a suitable enclosure.

Failure to follow these instructions will result in death or serious injury.

Air Circulation

Leave sufficient free space to help the air required for cooling purposes to circulate from the bottom to the top of the unit.

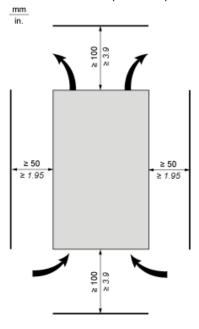

Overheating


To avoid the soft starter to overheat, respect the following recommendations:

- Mount the Altistart 22 Soft Starter within ± 10° of vertical.
- Do not locate the Altistart 22 Soft Starter near heat radiating elements.
- Electrical current through the Altistart 22 Soft Starter will result in heat losses that must be dissipated into the ambient air immediately surrounding the
- If several soft starters are installed in a control panel, arrange them in a row. Do not stack soft starters. Heat generated from the bottom soft starter ca

Mounting and Clearance

Mounting

Connection Between the Fan and the Altistart 22 Soft Starter

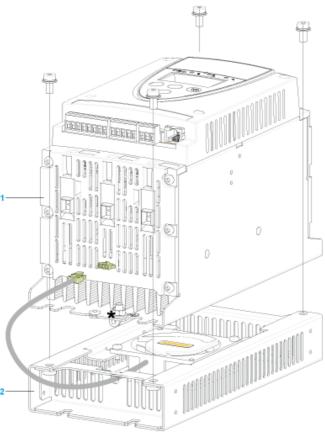

- 1 Altistart 22 Soft Starter
- **2** Fa

ATS22D47Q

Mounting and Clearance

Wall mounted or Floor-standing Enclosure with IP 23 Degree of protection


Introduction

To help proper air circulation in the soft starter, grilles and forced ventilation can be installed.

Ventilation Grilles




Forced Ventilation Unit




Connections and Schema

Power Terminal

Cage Style

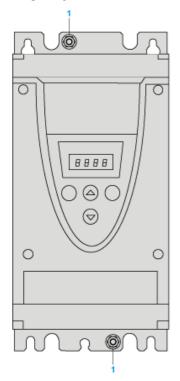

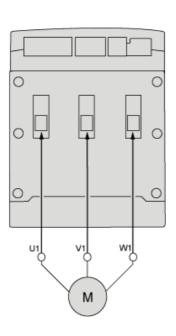

1 Ground connection

Power connections, minimum and maximum wiring capabilities, tightening torque

| | | | IEC cable | UL cable |
|----------------------------------|-------------------|-----|-----------|-------------|
| Power supply and output to motor | Size/gauge | min | 2.5 mm | 12 AWG |
| | | max | 16 mm | 4 AWG |
| | Tightening torque | | 3 N.m | 26.25 lb.in |
| | | max | 3 N.m | 26.25 lb.in |
| | Strip length | | 10 mm | 0.4 in. |


Power connections, minimum required wiring section

| IEC cable | UL cable |
|-------------------------|-------------------------|
| mm² (Cu 70°C/158°F) (1) | AWG (Cu 75°C/167°F) (1) |
| 10 | 6 |

Connections and Schema

230 Vac control, logic Inputs (LI) 24 Vdc, 3-wire control


With Line Contactor, Freewheel or Controlled Stop

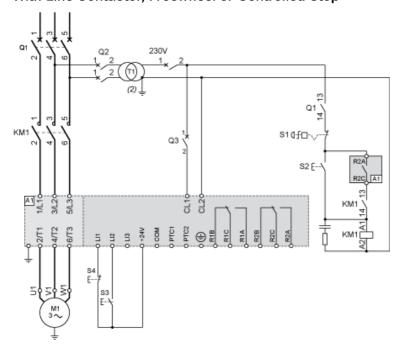

ATS22D47Q

Connections and Schema

230 Vac control, logic Inputs (LI) 24 Vdc, 2-wire control, freewheel stop

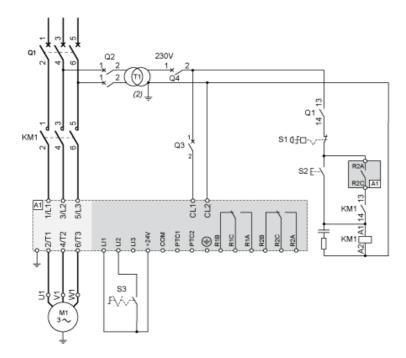

ATS22D47Q


Connections and Schema

Connection in the motor delta winding in series with each winding

Wiring

ATS22 soft starters connected to motors with the delta connections can be inserted in series in the motor windings.

The following wiring requieres particular attention. It is documented in the Altistart 22 Soft start - soft stop unit user manual. Please contact Schneider Electric commercial organisation for further informations.

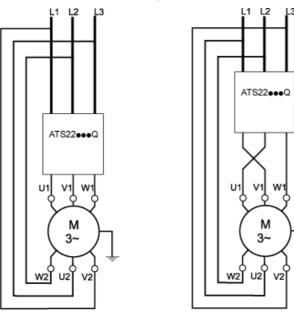


Example

A 400 V - 110 kW motor with a line current of 195 A (nominal current for the delta connection). The current in each winding is equal to 195/1.5 or 130 A. The rating is determined by selecting the soft starter with a permanent nominal current (ICL) just above this current.

Performance Curves

Motor Thermal Protection - Cold Curves

Curves

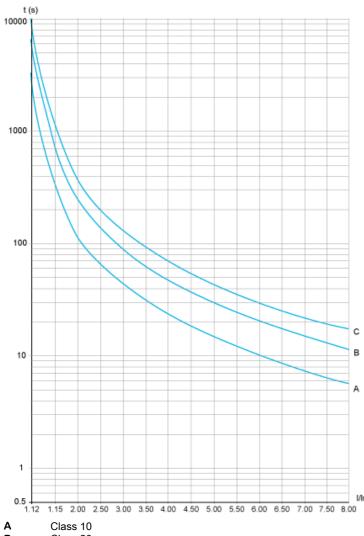

A Class 10 B Class 20 C Class 30

Trip time for a Standard Application (Class 10)

3.5 ln 32 s

Trip time for a Severe Application (Class 20)

3.5 ln 63 s

Trip time for a Severe Application (Class 30)


3.5 ln 95 s

ATS22D47Q

Performance Curves

Motor Thermal Protection - Warm Curves

Curves

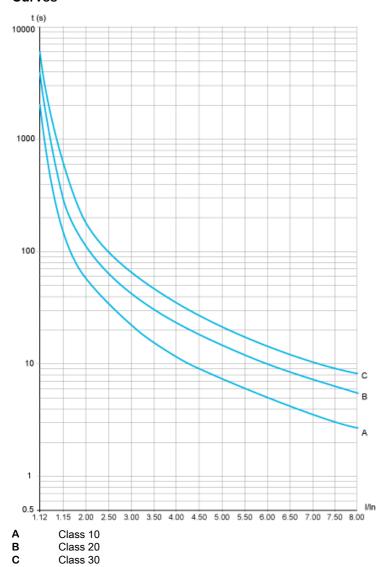

Trip time for a Standard Application (Class 10)

| • | • • | ` | • |
|--------|-----|---|---|
| 3.5 ln | | | |
| 16 s | | | |

Trip time for a Severe Application (Class 20)

| 3.5 ln | |
|--------|--|
| 32 s | |

Trip time for a Severe Application (Class 30)

| 3.5 ln | | |
|--------|--|--|
| 48 s | | |

Recommended replacement(s)