



soft starter-ATS22control 220V-power 230V(22kW)/400...440V(45kW)

ATS22D88Q

١	VI	а	ı	n	

Range of product	Altistart 22
Product or component type	Soft starter
Product destination	Asynchronous motors
Product specific application	Pumps and fans
Component name	ATS22
Network number of phases	3 phases
[Us] rated supply voltage	230440 V - 1510 %
Motor power kW	22 kW 230 V 45 kW 400 V 45 kW 440 V
Factory setting current	81 A
Power dissipation in W	66 W for standard applications
Utilisation category	AC-53A
Type of start	Start with torque control (current limited to 3.5 ln)
IcL starter rating	88 A for connection in the motor supply line for standard applications
IP degree of protection	IP20

Complementary

Assembly style	With heat sink
Function available	Internal bypass
Supply voltage limits	195484 V
Supply frequency	5060 Hz - 1010 %
Network frequency	4566 Hz
Device connection	To the motor delta terminals In the motor supply line
[Uc] control circuit voltage	230 V - 1510 % 50/60 Hz
Control circuit consumption	20 W
Discrete output number	2
Discrete output type	Relay outputs R1 230 V running, alarm, trip, stopped, not stopped, starting, ready C/O Relay outputs R2 230 V running, alarm, trip, stopped, not stopped, starting, ready C/O
Minimum switching current	100 mA at 12 V DC (relay outputs)

5 A 250 V AC resistive 1 relay outputs 5 A 30 V DC resistive 1 relay outputs 2 A 250 V AC inductive 0.4 20 ms relay outputs 2 A 30 V DC inductive 7 ms relay outputs
3
(LI1, LI2, LI3) logic, 5 mA 4.3 kOhm
24 V <= 30 V
Positive logic LI1, LI2, LI3 at State 0: < 5 V and <= 2 mA at State 1: > 11 V, >= 5 mA
0.41 lcl adjustable
750 Ohm
Modbus
1 RJ45
Serial
RS485 multidrop
4800, 9600 or 19200 bps
31
Phase failure: line Thermal protection: motor Thermal protection: starter
CE
Forced convection
Vertical +/- 10 degree
295 mm
145 mm
207 mm
12 kg
1525 kW at 200240 V 3 phases 3050 kW at 380440 V 3 phases
Soft starter
Conducted and radiated emissions level A conforming to IEC 60947-4-2 Damped oscillating waves level 3 conforming to IEC 61000-4-12 Electrostatic discharge level 3 conforming to IEC 61000-4-2 Immunity to electrical transients level 4 conforming to IEC 61000-4-4 Immunity to radiated radio-electrical interference level 3 conforming to IEC 61000-4-3 Voltage/current impulse level 3 conforming to IEC 61000-4-5
EN/IEC 60947-4-2
CCC CSA UL GOST C-Tick
1 gn (f= 13200 Hz) conforming to EN/IEC 60068-2-6 1.5 mm (f= 213 Hz) conforming to EN/IEC 60068-2-6
15 gn for 11 ms conforming to EN/IEC 60068-2-27
45 dB
Level 2 conforming to IEC 60664-1
095 % without condensation or dripping water conforming to EN/IEC 60068-2-3
-1040 °C (without derating)
4060 °C (with current derating 2.2 % per °C)

Operating altitude	<= 1000 m without derating
	> 1000< 2000 m with current derating of 2.2 % per additional 100 m

Packing Units

Unit Type of Package 1	PCE
Number of Units in Package 1	1
Package 1 Height	23.000 cm
Package 1 Width	30.800 cm
Package 1 Length	35.800 cm
Package 1 Weight	8.170 kg
Unit Type of Package 2	P06
Number of Units in Package 2	6
Package 2 Height	75.000 cm
Package 2 Width	60.000 cm
Package 2 Length	80.000 cm
Package 2 Weight	63.184 kg

Offer Sustainability

REACh Regulation	REACh Declaration
EU RoHS Directive	Pro-active compliance (Product out of EU RoHS legal scope) EU RoHS Declaration
Mercury free	Yes
China RoHS Regulation	China RoHS declaration
RoHS exemption information	Yes
WEEE	The product must be disposed on European Union markets following specific waste collection and never end up in rubbish bins

Contractual warranty


Warranty 18 months

ATS22D88Q

Dimensions Drawings

Frame Size B

Dimensions

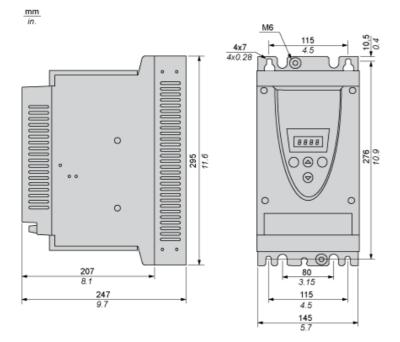

ATS22D88Q

Mounting and Clearance

Precautions

Standards

The Altistart 22 soft starter is compliant with pollution Degree 2 as defined in NEMA ICS1-1 or IEC 60664-1.

For environment pollution degree 3, install the Altistart 22 soft starter inside a cabinet type 12 or IP54.

DANGER


HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

ATS22 soft starters are open devices and must be mounted in a suitable enclosure.

Failure to follow these instructions will result in death or serious injury.

Air Circulation

Leave sufficient free space to help the air required for cooling purposes to circulate from the bottom to the top of the unit.

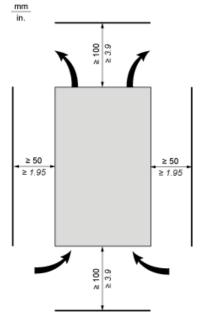

Overheating


To avoid the soft starter to overheat, respect the following recommendations:

- Mount the Altistart 22 Soft Starter within ± 10° of vertical.
- Do not locate the Altistart 22 Soft Starter near heat radiating elements.
- Electrical current through the Altistart 22 Soft Starter will result in heat losses that must be dissipated into the ambient air immediately surrounding the
- If several soft starters are installed in a control panel, arrange them in a row. Do not stack soft starters. Heat generated from the bottom soft starter ca

Mounting and Clearance

Mounting

Connection Between the Fan and the Altistart 22 Soft Starter

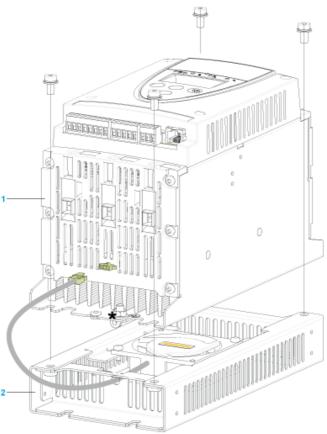

- 1 Altistart 22 Soft Starter
- 2 Fa

ATS22D88Q

Mounting and Clearance

Wall mounted or Floor-standing Enclosure with IP 23 Degree of protection


Introduction

To help proper air circulation in the soft starter, grilles and forced ventilation can be installed.

Ventilation Grilles



Forced Ventilation Unit





ATS22D88Q

Connections and Schema

Power Terminal

Cage Style

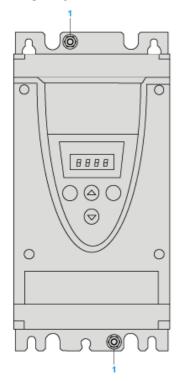

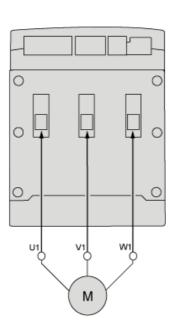

1 Ground connection

Power connections, minimum and maximum wiring capabilities, tightening torque

			IEC cable	UL cable
Power supply and output to motor	Size/gauge	min	4 mm (a)	10 AWG (a)
		max	50 mm	1/0 AWG
	Tightening torque	min	8 N.m	70 lb.in
		max	8 N.m	70 lb.in
	Strip length		15 mm	0.6 in.


Power connections, minimum required wiring section

IEC cable	UL cable
mm² (Cu 70°C/158°F) (1)	AWG (Cu 75°C/167°F) (1)
35	2

Connections and Schema

230 Vac control, logic Inputs (LI) 24 Vdc, 3-wire control


With Line Contactor, Freewheel or Controlled Stop

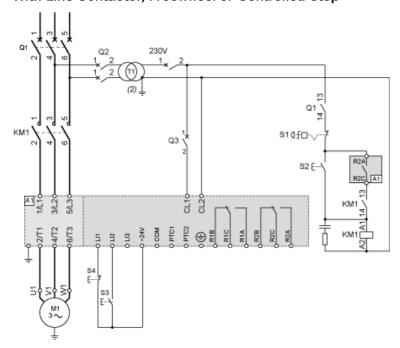

ATS22D88Q

Connections and Schema

230 Vac control, logic Inputs (LI) 24 Vdc, 2-wire control, freewheel stop

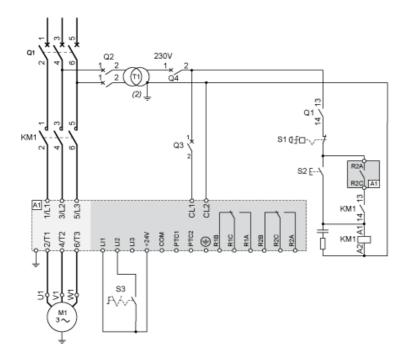

ATS22D88Q


Connections and Schema

Connection in the motor delta winding in series with each winding

Wiring

ATS22 soft starters connected to motors with the delta connections can be inserted in series in the motor windings.

The following wiring requieres particular attention. It is documented in the Altistart 22 Soft start - soft stop unit user manual. Please contact Schneider Electric commercial organisation for further informations.

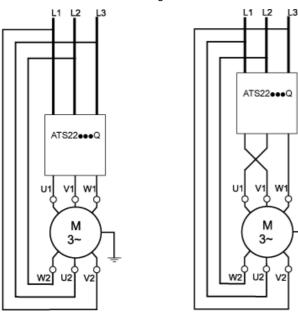


Example

A 400 V - 110 kW motor with a line current of 195 A (nominal current for the delta connection). The current in each winding is equal to 195/1.5 or 130 A. The rating is determined by selecting the soft starter with a permanent nominal current (ICL) just above this current.

Performance Curves

Motor Thermal Protection - Cold Curves

Curves

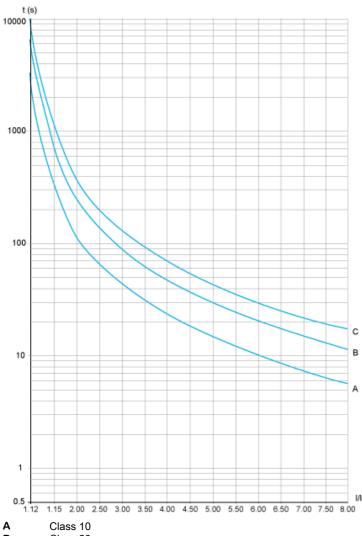

A Class 10 B Class 20 C Class 30

Trip time for a Standard Application (Class 10)

3.5 ln 32 s

Trip time for a Severe Application (Class 20)

3.5 ln 63 s

Trip time for a Severe Application (Class 30)


3.5 ln 95 s

ATS22D88Q

Performance Curves

Motor Thermal Protection - Warm Curves

Curves

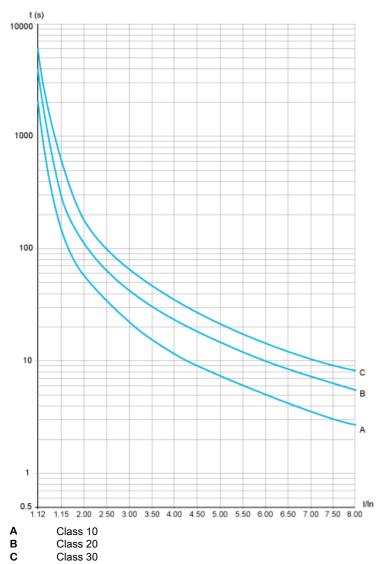

Trip time for a Standard Application (Class 10)

•	• •	`			
3.5 ln					
16 s					

Trip time for a Severe Application (Class 20)

3.5 ln	
32 s	

Trip time for a Severe Application (Class 30)

3.5 ln	
48 s	

Recommended replacement(s)